# Gestra

# Level Switch NRS 1-54 NRS 1-55



Original Installation Instructions 819178-01

# Contents

#### Important notes

Usage for the intended purpose4	
Function4	
Safety note5	

### **Directives and standards**

VdTÜV Bulletin "Wasserstand 100" (= Water Level 100)
LV (Low Voltage) Directive and EMC (Electromagnetic Compatibility)
ATEX (Atmosphère Explosible)
Note on the Declaration of Conformity / Declaration by the Manufacturer CC

### **Technical data**

NRS 1-54, NRS 1-55	8
Scope of supply	. 8

### In control cabinet: Mounting level switch

Dimensions NRS 1-54, NRS 1-55	9
Key	
Installation in control cabinet	
Name plate / marking	10
F	

### In control cabinet: Wiring level switch

Wiring diagram for level switch NRS 1-54, NRS 1-55	11
Key	11
Connecting supply voltage	12
Connecting output contacts	12
Connecting level electrode	12
Tools	

### In the plant: Wiring level electrode

Level switch NRS 1-54: Connecting several level electrodes (fill control)	13
Key	13
Level switch NRS 1-55: Connecting several level electrodes (fill control)	14
Key	14
Connecting level electrode	15

Contents - continued -	
	Page
Basic settings	
Factory setting	15

### **Commissioning procedure**

Changing response sensitivity and function		16
Changing response sensitivity		
Changing function		
Level switch NRS 1-54: Checking switchpoint and function		
Level switch NRS 1-55: Checking switchpoint and function	. 20 -	- 21

### Operation, alarm and test

Level switch NRS 1-54: Indications and operation	22
Level switch NRS 1-55: Indications and operation	

### **Further notes**

Protection against high frequency interference	24
Decommissioning / replacing the equipment	
Disposal	

## **Important Notes**

#### Usage for the intended purpose

The level switch NRS 1-54, NRS 1-55 in conjunction with level electrodes NRG 1.-.. and ER 5. is used as water level controller, for instance in steam boilers, (pressurized) hot-water installations as well as condensate and feedwater tanks. The level switch detects and indicates in addition a MIN or a MAX water level.

The level switch NRS 1-54, NRS 1-55 can be used in combination with the following level electrodes:

Level electrodes					
NRG 10-52, NRG 16-52 Electrode with 4 rods	NRG 16-36 Electrode with 4 rods	NRG 16-4 Electrode with 1 rod	ER 50 Electrode with 4 rods	ER 56 Electrode with 4 rods	

#### Function

The operation of the level switch NRS 1-54, NRS 1-55 is based on the conductive measuring principle using the electrical conductivity of water. The level switch is designed for different electrical conductivities and for connecting three level electrode rods.

The level switch works as on-off water level controller (for fill or discharge control) and indicates in addition when the preset MAX or MIN water level (MAX: NRS 1-54; MIN: NRS 1-55) is reached.

The length of the associated electrode rods determines the switchpoints for water level control and MIN or MAX water level.

The equipment monitors the water level by sensing whether the electrode tips are exposed or immersed and - by energizing or de-energizing the controller output contact - switches the feedwater pump on or off. The LED "Pump" is illuminated when the feedwater pump is switched on by the level switch.

The level switch detects that the MIN or MAX water level is reached when the corresponding electrode rod is exposed or submerged. After the de-energizing delay has elapsed, the MIN / MAX output contact is switched over. At the same time the MIN or the MAX LED changes from green to red.

A MIN or MAX alarm can be simulated by pressing the button "Test".

# Important Notes - continued -

#### Safety note

The equipment fulfils a safety function and must only be installed, wired and commissioned by qualified and competent staff.

Retrofitting and maintenance work must only be performed by qualified staff who - through adequate training - have achieved a recognised level of competence.



# Danger

The terminal strips of the equipment are live during operation. This presents the danger of electric shock! **Always cut off power supply** to the equipment before mounting, removing or connect-

ing the terminal strips!



## Attention

The name plate specifies the technical features of the equipment. Note that any piece of equipment without its specific name plate must neither be commissioned nor operated.

# **Directives and Standards**

#### VdTÜV Bulletin "Wasserstand 100" (= Water Level 100)

The level switch NRS 1-54, NRS 1-55 in conjunction with level electrodes NRG 10-52, NRG 16-52; NRG 16-36, NRG 16-4 and ER 5.-1 is type approved to VdTÜV Bulletin "Water Level 100". The VdTÜV Bulletin "Wasserstand (= Water Level) 100" specifies the requirements made on water level control and limiting equipment for boilers.

#### LV (Low Voltage) Directive and EMC (Electromagnetic Compatibility)

The equipment meets the requirements of the Low Voltage Directive 2014/35/EU and the EMC Directive 2014/30/EU.

#### ATEX (Atmosphère Explosible)

According to the European Directive 20014/34/EU the equipment must not be used in explosion risk areas.



Note

The level electrodes NRG 10-52, NRG 16-52, NRG 16-36, NRG 16-4 and ER 5.-1 are simple items of electrical equipment as specified in EN 60079-11 section 5.7. According to the European Directive 2014/34/EU the equipment must be equipped with approved Zener barriers if used in potentially explosive areas. Applicable in Ex zones 1, 2 (1999/92/EC). The equipment does not bear an Ex marking.

#### Note on the Declaration of Conformity / Declaration by the Manufacturer C€

For details on the conformity of our equipment according to the European Directives see our Declaration of Conformity or our Declaration of Manufacturer.

The current Declaration of Conformity / Declaration of Manufacturer are available in the Internet under www.gestra.com/documents or can be requested from us.

# **Technical Data**

#### NRS 1-54, NRS 1-55

Supply voltage

24 VDC +/- 20 %

Fuse external 0.5 A (semi-delay)

### Power consumption

2 VA

#### **Connection of level electrode**

3 inputs for level electrode NRG 10-52, NRG 16-52, NRG 16-36, NRG 16-4 and ER 5.-1, 4 poles with screen

#### **Electrode voltage**

 $5\,V_{SS}$ 

**Response sensitivity** (Electrical conductivity of water at 25 °C)  $> 0.5 \dots < 1000 \text{ µS/cm or } > 10 \dots < 10 000 \text{ µS/cm}$  (switch-selectable)

#### **Outputs**

2 volt-free change-over contacts, 8 A 250 V AC / 30 V DC cos  $\phi$  = 1.

De-energizing delay: 3 sec. (MIN or MAX alarm).

Provide inductive loads with RC combinations according to manufacturer's specification to ensure interference suppression.

#### Indicators and adjustors

1 Test button for MIN / MAX alarm,

1 red/green LED for indicating operating mode and MIN / MAX alarm,

1 red/green LED for indicating operating mode and Pump ON

1 green LED for "Power ON",

1 code switch with 4 poles for changing the sensitivity and function

#### Housing

Housing material: base: polycarbonate, black; front: polycarbonate, grey Conductor size: 1 x 4.0 mm^2 solid per wire or

1 x 2.5 mm<sup>2</sup> per stranded wire with sleeve to DIN 46228 or

2 x 1.4 mm<sup>2</sup> per stranded wire with sleeve to DIN 46228;

Terminal strips can be detached

Fixing of housing: Mounting clip on supporting rail TH 35, EN 60715

### **Electrical safety**

Pollution degree 2 for installation in control cabinet with protection IP 54, completely insulated

#### Protection

Housing: IP 40 to EN 60529 Terminal strip: IP 20 to EN 60529

#### Weight

approx. 0.2 kg

NRS 1-54, NRS 1-55 - continued -

#### Ambient temperature

when system is switched on: 0 .... 55 °C, during operation: -10 ... 55 °C

### **Transport temperature**

 $-20 \dots +80$  °C (< 100 hours), defrosting time of the de-energized equipment before it can be put into operation: 24 hours.

#### Storage temperature

 $-20 \hdots + 70 \hdots$  c, defrosting time of the de-energized equipment before it can be put into operation: 24 hours.

#### **Relative humidity**

max. 95 %, no moisture condensation

#### Approvals:

TÜV certificate VdTÜV Bulletin "Water Lever 100" (= Water Level 100): Requirements made on water level limiting & control equipment. Type approval no. TÜV . WR/WB . XX-424 (see name plate)

#### Scope of supply

#### NRS 1-54


1 Level switch NRS 1-54 1 Installation manual

#### NRS 1-55

1 Level switch NRS 1-55 1 Installation manual

# In control cabinet: Mounting level switch


**Dimensions NRS 1-5..** 

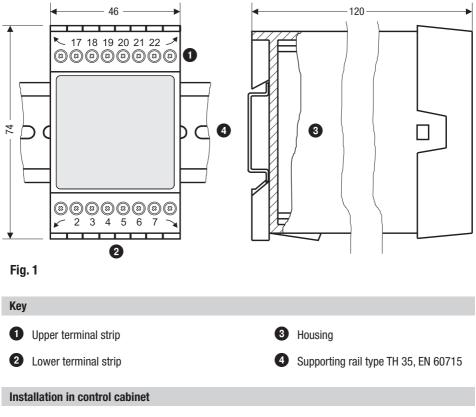


The level switch NRS 1-54, NRS 1-55 is clipped onto the support rail ④ type TH 35, EN 60715 in the control cabinet. Fig. 1

# In control cabinet: Mounting level switch - continued -

#### Name plate / marking

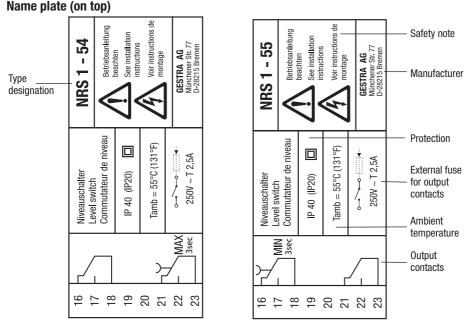


#### Name plate (at the bottom)

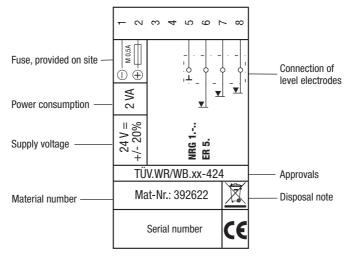


### Fig. 2

# In control cabinet: Wiring level switch

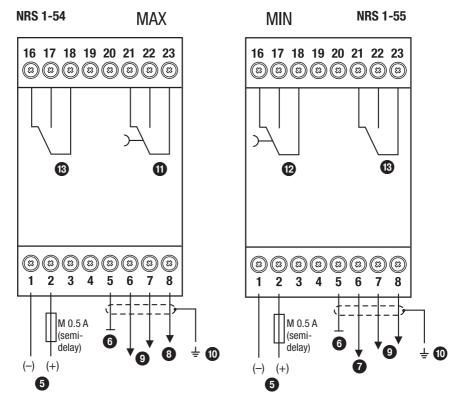

Wiring diagram for level switch NRS 1-54, NRS 1-55

### Fig. 3

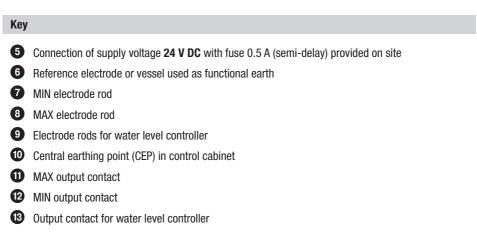

# In control cabinet: Wiring level switch - continued -

#### **Connecting supply voltage**

The equipment is supplied with 24 V DC and fused with an external semi-delay fuse 0.5 A. Please use a safety power supply unit with safe electrical isolation.

The power supply unit must be electrically isolated from dangerous contact voltages and must meet at least the requirements on double or reinforced isolation according to one of the following standards: DIN EN 50178, DIN EN 61010-1, DIN EN 60730-1 or DIN EN 60950.

#### **Connecting output contacts**

Wire the upper terminal strip **1** (terminals 16-18, 21-23) according to the desired switching functions. Provide an external slow-blow fuse 2.5 A for the output contacts.

When switching off inductive loads, voltage spikes are produced that may impair the operation of control and measuring systems. Connected inductive loads must be provided with suppressors such as RC combinations as specified by the manufacturer.

#### **Connection of level electrode**

To connect the level electrode(s) use screened multi-core control cable with a min. conductor size  $0.5 \text{ mm}^2$ , e. g. LiYCY 4 x  $0.5 \text{ mm}^2$ , max. length: 100 m.

Wire terminal strip in accordance with the wiring diagram. Fig. 3.

Connect the screen only once to the central earthing point (CEP) in the control cabinet.

Make sure that connecting cables leading to the level electrodes are segregated and run separately from power cables.



#### Attention

Do not use unused terminals as support point terminals.


#### Tools

■ For all functions: Screwdriver 0.8 x 4.0 or 0.8 x 4.5, completely insulated according to VDE 0680-1.


# In the plant: Wiring level electrode

NRS 1-54 NRS 1-54 000000000 000000000 1 2 3 4 5 6 7 8 1 2 3 4 5 6 7 8 ÷ 📵 Ð ſ 5 03 9 0 1 0 2 0 7 ĭ ă Š õ 8 14 ŒЭ NRG 1.-52 NRG 16-36 MAX MAX Pump OFF Pump OFF Fig. 4 Fig. 5 Pump ON Pump ON NRS 1-54 NRS 1-54 000000000 88888888 1 2 3 4 5 6 7 8 1 2 3 4 5 6 7 8 - -- -Ð Ð 0 ර 2 3 02 0 9 3 4 5 1 (16) 7 ER5. ER 5... MAX MAX Pump OFF Pump OFF Fig. 6 Fig. 7 Pump ON Pump ON NRS 1-54 0000000000 1 2 3 4 5 6 7 8

#### Level switch NRS 1-54: Connecting several level electrodes (fill control)



#### Key





- **15** Level electrode NBG 16-36
- 16 Level electrode ER 5..., 4 pole connector
- 17 Level electrode ER 5.., 6 pole connector
- Level electrode NRG 16-4
- 19 Central earthing point (CEP) in control cabinet


# In the plant: Wiring level electrode - continued -

NRS 1-55 NRS 1-55 88888888 1 2 3 4 5 6 7 8 000000000 1 2 3 4 5 6 7 8 ----Ð Ð 9 0 5 6 7 0 2 0 3 ċ ĭ ă 8 14 ſБ NRG 1.-52 NRG 16-36 Pump ON Pump ON Pump OFF Pump OFF Fig. 9 Fig. 10 MIN MIN NRS 1-55 NRS 1-55 88888888 000000000 1 2 3 4 5 6 7 8 1 2 3 4 5 6 78 - - - -Ð ÷19 ъ 1 02 3 4 5 5 2 9 6 3 16 T. Ø ER 5... ER5. Pump ON Pump ON Pump OFF Pump OFF Fig. 12 Fig. 11 MIN MIN NRS 1-55 88888888 1 2 3 4 5 6 7 8 19 т Т З Ϊš 9 03 18 NRG16-4 ĭ NRG16-4 NRG16-4 Pump ON Pump OFF Fig. 13 MIN

#### Level Switch NRS 1-55: Connecting several level electrodes (drain control)

#### Key





- 16 Level electrode ER 5.., 4 pole connector
- Level electrode ER 5.., 6 pole connector
- 18 Level electrode NRG 16-4
- (19) Central earthing point (CEP) in control cabinet

# In the plant: Wiring level electrode - continued -

#### **Connection of level electrode**

The level switch NRS 1-54, NRS 1-55 can be used in combination with the following level electrodes:

Level electrodes					
NRG 10-52, NRG 16-52 Electrode with 4 rods	NRG 16-36 Electrode with 4 rods	NRG 16-4 Electrode with 1 rod	ER 50 Electrode with 4 rods	ER 56 Electrode with 4 rods	

To connect the level electrode(s) use screened multi-core control cable with a min. conductor size  $0.5 \text{ mm}^2$ , e. g. LiYCY 4 x  $0.5 \text{ mm}^2$ , max. length: 100 m.

Wire terminal strip in accordance with the examples **Fig. 4 to 13**. Check the connection of the screen to the central earthing point (CEP) in the control cabinet.



#### Attention

- Please observe the instructions given in the installation & operating manual for the NRG 10-52, NRG 16-52, NRG 16-36, NRG 16-4 and ER 5.-1!
- Make sure that connecting cables leading to the level electrodes are segregated and run separately from power cables.

## **Factory settings**

#### Level Switch NRS 1-54

The level switch features the following factory set default values:

- Response sensitivity: 10 µS/cm (at 25 °C)
- Function "Fill control"

#### Level Switch NRS 1-55

The level switch features the following factory set default values:

- Response sensitivity: 10 µS/cm (at 25 °C)
- Function "Discharge control"

# **Commissioning procedure**



#### Danger

The terminal strips of the equipment are live during operation.


This presents the danger of electric shock!

Always **cut off power supply** to the equipment before mounting, removing or connecting the terminal strips!

#### Changing response sensitivity and function

The response sensitivity and the function are determined by the code switch 0 setting. To change the code switch setting proceed as follows:

- Cut off supply voltage.
- Remove lower terminal strip. Fig. 14
  - Insert a screwdriver to the right and left between the terminal strip and the front frame.
  - Unlock terminal strip on the left and right side. For this purpose move screwdriver in direction of the arrow.
  - Remove the terminal strip.

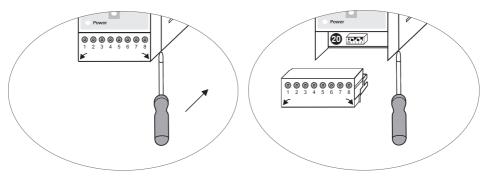

### Fig. 14

After the new code switch settings have been established as new defaults:

- Re-attach lower terminal strip.
- Apply mains voltage, equipment is re-started.

#### **Changing response sensitivity**

If the electrical conductivity of water is < 10  $\mu$ S/cm at 25°C set switch S4 of the code switch 20 to 0N (= sensitivity of response 0.5  $\mu$ S/cm).

#### **Changing function**

The NRS 1-54 is configured at our works as fill controller and the NRS 1-55 as discharge controller. To change the function set the switches S1 to S3 of code switch 0 to the positions indicated in table **Fig. 15**.

Code switch @				
Level switch NRS 1-54	S 1	S 2	S 3	Toggle switch, white
Fill control	ON	ON	OFF	ON 1 2 3 4
Discharge control	ON	OFF	ON	ON 1 2 3 4
Level switch NRS 1-55				Toggle switch, white
Fill control	OFF	OFF	ON	ON 1 2 3 4
Discharge control	OFF	ON	ON	ON 1 2 3 4

grey = factory setting

Fig. 15

#### Level switch NRS 1-54: Checking switchpoint and function

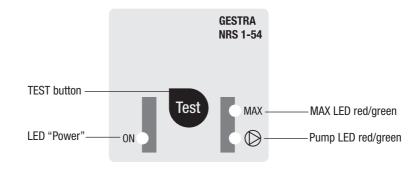


Fig. 16



### Danger

To commission the equipment switch water level control system to manual operation. Make sure that installation is in manual operation mode when you fill or discharge the steam boiler or vessel.

Start			
Activity	Display	Function	
	LED "Power" is illuminated.		
Switch on supply voltage.	MAX LED and pump LED are illuminated as a function of the water level		

Checking switchpoint and function (fill control)		
Lower water level until it is below "Pump ON" level. Electrode rod "Pump ON" is exposed.	Pump LED illuminated green.	Pump output contact 17/18 closed, 16/18 open.
Fill vessel until water level "Pump OFF" is exceeded. Electrode rod "Pump OFF" is submerged.	Pump LED is not illuminated.	Pump output contact 16/18 closed, 17/18 open.

Checking switchpoint and function (discharge control)			
Fill vessel until water level "Pump ON" is exceeded. Electrode rod "Pump ON" is submerged.	Pump LED illuminated green.	Pump output contact 17/18 closed, 16/18 open.	
Lower water level until it is below "Pump OFF" level. Electrode rod "Pump OFF" is exposed.	Pump LED is not illuminated.	Pump output contact 16/18 closed, 17/18 open.	

### Level switch NRS 1-54: Checking switchpoint and function - continued -

Checking switchpoint and function (MAX alarm)		
Fill vessel until MAX level is	MAX LED flashes red.	De-energizing delay is running.
exceeded. MAX electrode rod enters the water.	MAX LED illuminated red	Time delay has elapsed. MAX output contact 21/23 closed, 22/23 open.

Possible installation faults			
Status and indication	Error	Remedy	
Water level below MAX	Electrode rods are too long.	Cut electrode rods to the length dictated by the switchpoints.	
switchpoint, MAX LED illuminated red.	If installed inside the boiler: Up- per vent hole in protection tube does not exist or is obstructed.	Check installation of level electrode. Make sure that the level in the protection tube corresponds to the actual water level.	
	Electrode rods are too short.	Replace level electrode and cut electrode rods to the length dictated by the switchpoints.	
Switchpoint MAX water level reached, MAX LED illuminated green.	The earth connection to the vessel is interrupted.	Clean seating surfaces and screw in level elec- trode with metallic joint ring. Do not insulate the electrode with hemp or PTFE tape!	
	Electrical conductivity of the boiler water too low.	Change response sensitivity to 0.5 $\mu\text{S/cm}$	
	Upper vent hole flooded.	Check installation of level electrode. Make sure that the level in the protection tube corresponds to the actual water level.	
Water level between MAX and pump ON / OFF. MAX LED and pump LED are flashing simultaneously.	Electrical connections of elec- trode rods are mixed up.	Check and change the electrical connection of the level electrode.	

#### Level switch NRS 1-55: Checking switchpoint and function

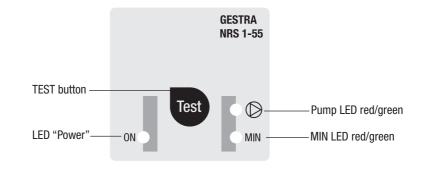


Fig. 17



### Danger

To commission the equipment switch water level control system to manual operation. Make sure that installation is in manual operation mode when you fill or discharge the steam boiler or vessel.

Start			
Activity	Display	Function	
	LED "Power" is illuminated.		
Switch on supply voltage.	MIN LED and pump LED are illuminated as a function of the water level		

Checking switchpoint and function (fill control)		
Lower water level until it is below "Pump ON" level. Electrode rod "Pump ON" is exposed.	Pump LED illuminated green.	Pump output contact 22/23 closed, 21/23 open.
Fill vessel until water level "Pump OFF" is exceeded. Electrode rod "Pump OFF" is submerged.	Pump LED is not illuminated.	Pump output contact 21/23 closed, 22/23 open.

Checking switchpoint and function (discharge control)			
Fill vessel until water level "Pump ON" is exceeded. Electrode rod "Pump ON" is submerged.	Pump LED illuminated green.	Pump output contact 22/23 closed, 21/23 open.	
Lower water level until it is below "Pump OFF" level. Electrode rod "Pump OFF" is exposed.	Pump LED is not illuminated.	Pump output contact 21/23 closed, 22/23 open.	

# Level switch NRS 1-55: Checking switchpoint and function - continued -


Checking switchpoint and function (MIN alarm)		
Lower water level until it is	MIN LED flashes red.	De-energizing delay is running.
below MIN level. MIN electrode rod is exposed.		Time delay has elapsed. MIN output contact 16/18 closed, 17/18 open.

Possible installation faults			
Status and indication	Error	Remedy	
Water level below MIN	Electrode rods are too long.	Cut electrode rods to the length dictated by the switchpoints.	
switchpoint, MIN LED illuminated green.	If installed inside the boiler: Up- per vent hole in protection tube does not exist or is obstructed.	Check installation of level electrode. Make sure that the level in the protection tube corresponds to the actual water level.	
	Electrode rods are too short.	Replace level electrode and cut electrode rods to the length dictated by the switchpoints.	
Switchpoint MIN water level exceeded, MIN LED illuminated red.	The earth connection to the vessel is interrupted.	Clean seating surfaces and screw in level elec- trode with metallic joint ring. Do not insulate the electrode with hemp or PTFE tape!	
	Electrical conductivity of the boiler water too low.	Change response sensitivity to 0.5 $\mu\text{S/cm}$	
	Upper vent hole flooded.	Check installation of level electrode. Make sure that the level in the protection tube corresponds to the actual water level.	
Water level between MIN and pump ON / OFF. MIN LED and pump LED are flashing simultaneously.	Electrical connections of elec- trode rods are mixed up.	Check and change the electrical connection of the level electrode.	

### 21

# **Operation, Alarm and Test**

#### Level switch NRS 1-54: Indicators and adjustors

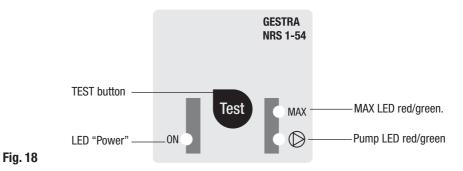

Fill control			
Activity	Display	Function	
Level below switchpoint "Pump ON"	Pump LED illuminated green.	Pump output contact 17/18 closed, 16/18 open.	
Level above switchpoint "Pump OFF"	Pump LED is not illuminated.	Pump output contact 16/18 closed, 17/18 open.	


Discharge control		
Switchpoint "Water level - pump ON" exceeded	Pump LED illuminated green.	Pump output contact 17/18 closed, 16/18 open.
Level below switchpoint "Water level - pump OFF"	Pump LED is not illuminated.	Pump output contact 16/18 closed, 17/18 open.

MAX alarm		
Water level above MAX	MAX LED flashes red.	De-energizing delay is running.
switchpoint.	MAX LED illuminated red	Time delay has elapsed. MAX output contact 21/23 closed, 22/23 open.

Test MIN alarm		
During operation:	MAX LED flashes red.	De-energizing delay is running.
Level below switchpoint MAX water level, MAX LED illuminated green. Press and hold down button "Test".	MAX LED is illuminated red for 3 sec.	MAX output contact 21/23 closed, 22/23 open.
The test is finished. Release button "Test". Equipment returns to operating mode.	Note: If you continue to hold down the Test button, a new test is started. You can abort the test any moment by releasing the Test button.	

# Operation, Alarm and Test - continued -

#### Level switch NRS 1-55: Indicators and adjustors

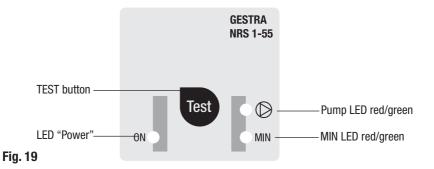

Fill control		
Activity	Display	Function
Level below switchpoint "Pump ON"	Pump LED illuminated green.	Pump output contact 22/23 closed, 21/23 open.
Level above switchpoint "Pump OFF"	Pump LED is not illuminated.	Pump output contact 21/23 closed, 22/23 open.

Discharge control		
Switchpoint "Water level - pump ON" exceeded	Pump LED illuminated green.	Pump output contact 22/23 closed, 21/23 open.
Level below switchpoint "Water level - pump OFF"	Pump LED is not illuminated.	Pump output contact 21/23 closed, 22/23 open.

MIN alarm		
Water level below MIN	MIN LED flashes red.	De-energizing delay is running.
switchpoint.	MIN LED illuminated red	Time delay has elapsed. MIN output contact 16/18 closed, 17/18 open.

Test MIN alarm		
During operation:	MIN LED flashes red.	De-energizing delay is running.
Switchpoint "MIN water level" exceeed, MIN LED illuminated green. Press and hold down button "Test".	MIN LED is illuminated red for 3 sec.	MIN output contact 16/18 closed, 17/18 open.
The test is finished. Release button "Test". Equipment returns to operating mode.	Note: If you continue to hold down the Test button, a new test is started. You can abort the test any moment by releasing the Test button.	

# **Further Notes**

#### Action against high frequency interference

High-frequency interference can be caused by out-of-phase switching operations. Should sporadic failures or malfunctions occur take the following remedial actions in order to suppress interference:

- Provide inductive loads with RC combinations according to manufacturer's specification to ensure interference suppression.
- Increase the distance to sources of interference.
- Check the connection of the screen to the central earthing point (CEP) in the control cabinet.
- HF interference suppression by means of hinged-shell ferrite rings.
- Make sure that connecting cables leading to the level electrodes are segregated and run separately from power cables.

#### Decommissioning / replacing the equipment

- Switch off supply voltage and cut off power supply to the equipment.
- Remove the lower and upper terminal strips. Fig. 14.
- Release the white fixing slide at the bottom of the equipment and take the equipment off the supporting rail.

#### Disposal

For the disposal of the equipment observe the pertinent legal regulations concerning waste disposal.

If faults occur that are not listed above or cannot be corrected, please contact our service centre or authorized agency in your country.

# For your Notes

# For your Notes

# For your Notes

# Gestra<sup>®</sup>

Agencies all over the world: www.gestra.de

# **GESTRA AG**

 Münchener Straße 77

 28215 Bremen

 Germany

 Telefon
 +49 421 3503-0

 Telefax
 +49 421 3503-393

 E-mail
 info@de.gestra.com

 Web
 www.gestra.de